

U.S. Government

Federal law prohibits removal of this label before consumer purchase.


# ENERGYGUIDE

Central Air Conditioner  
Cooling Only  
Split System

FRASER-JOHNSTON BY JOHNSON CONTROLS  
Model TC3B3621

## Efficiency Rating (SEER)\*

**13.00 - 14.75**



### Range of Similar Models

\*Seasonal Energy Efficiency Ratio


▼▼ This system's efficiency rating depends on the coil your contractor installs with this unit. Ask for details.

For energy cost info, visit [productinfo.energy.gov](http://productinfo.energy.gov)

## Notice

The installed system must meet minimum federal regional efficiency standards.

See [productinfo.energy.gov](http://productinfo.energy.gov) for certified coil combinations.

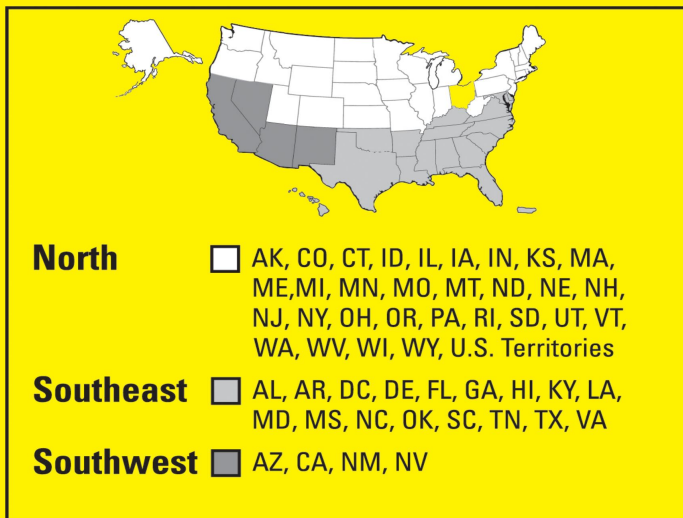

## Minimum Standards

|       | North | Southeast | Southwest |
|-------|-------|-----------|-----------|
| SEER  | 13    | 14        | 14        |
| EER†  |       |           | 12.2      |
| EER†† |       |           | 11.7      |

† Units with rated capacity of less than 45,000 btu/h

†† Units with rated capacity equal to or greater than 45,000 btu/h

**Energy Efficiency Ratio (EER):** could range from 11.00 to 12.25, depending on the coil installed with this unit